
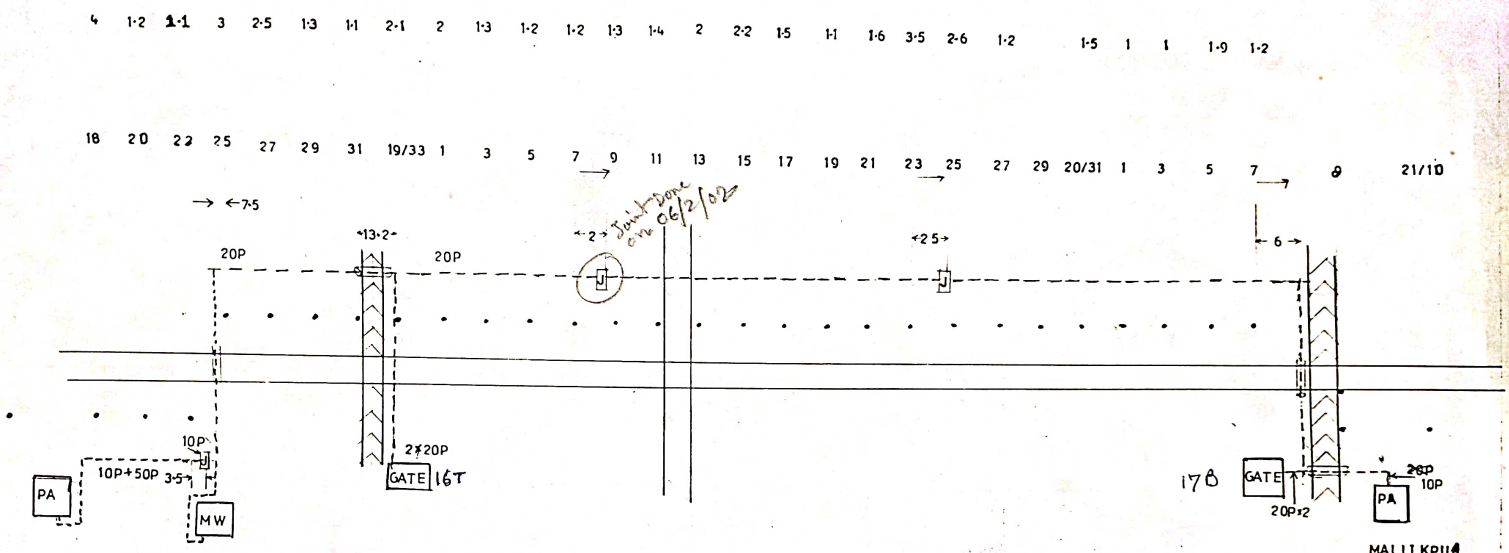


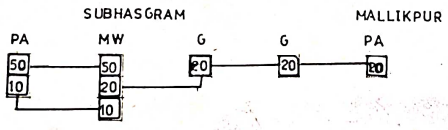


SHEET NO 1 OF 21

FIRM	PERFECTO ELECTRICALS
ADDRESS	18 M B ST CAL 7
CLIENT	C S E(CON)E RLY CAL
CONTRACT	18 GHZ CNL COMMUN
TITLE	CABLE ROUTE DRG
STATION	SUBHASGRAM
DRG NO	PE/SS/CR/021
CHKD BY	DATE 10.3.95


6·5 17·2 27 3·2 4 4·2 4 5 1·2 1·1 1·7 1 2·2 1·2 3 1·9 1·7 1·9 2·6 1·5 1·7 2 1 2·2 2·3 2·5 2·7 2·5 1·7 1·2 1·5 1·6 1·2 1·5 1·2 1·5 1·6

11 9 7 5 3 24/1 39 37 35 33 31 29 27 25 23 21 19 17 15 13 11 9 7 5 3 23/1 31 29 27 25 23 21 19 17 15 13 11 22/0

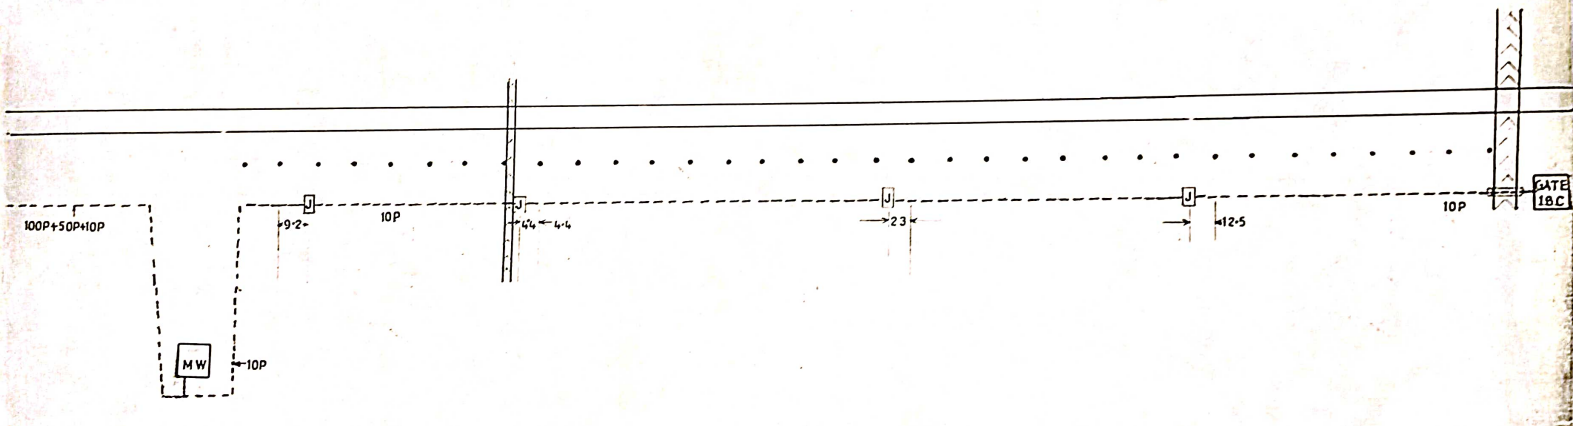

SHEET NO 1 OF 22

FIRM	PERFECTO ELECTRICALS
ADDRESS	18 M. B. ST. CAL 7
CLIENT	C. S. E (CONJE. RLY, CAL
CONTRACT	18 GHZ CNL. COMMUN.
TITLE	CABLE ROUTE DRG.
STATION	BARUIPUR
DRG. NO	PE/SS/CR/022
CHKD. BY	DATE 10.8.95

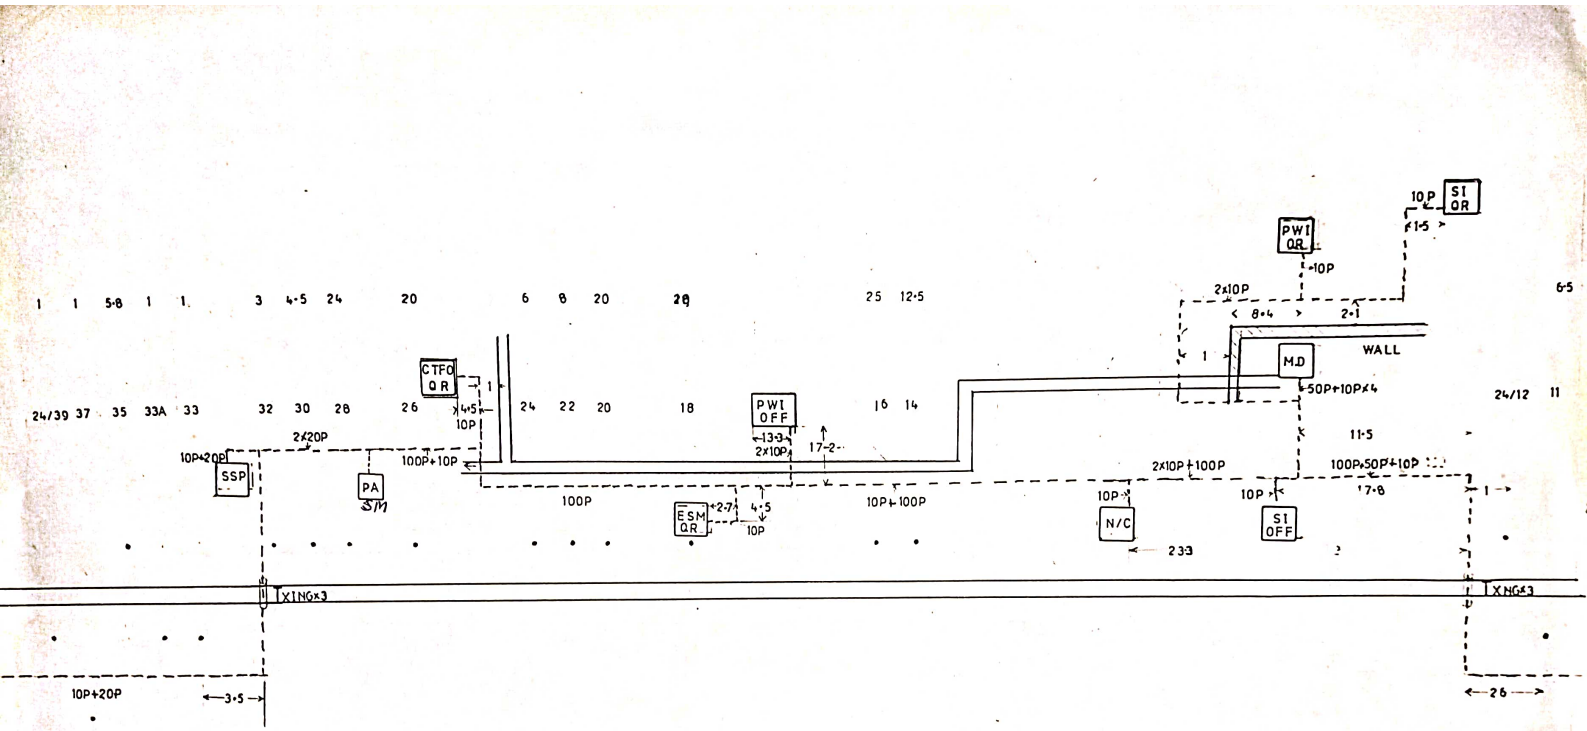


FIRM	PERFECTO ELECTRICALS
ADDRESS	18 M B ST CAL 7
CLIENT	C S E(CONT)E RLY CAL
CONTRACT	18 GHZ CNL COMMUN
TITLE	CABLE ROUTE DRG
STATION	BARUIPUR
DRG NO	PE/SS/CR/022
CHKD BY	DATE 10.3.95


DISTANCE BETWEEN OHE MAST & TRENCH

2·3 9·5 9·6 9·8 9·7 7·2 7·5 7·2 6·5 6·3 7·2 7·2 7·4 7·4 7·2 7·7 7·6 8 7·3 7·5 7·3 6 8 7·2 8·5 8·2 7·2 6·5 6·7 6·8 7 6·5 6·3 1 1 2·2 2·3 1·2 6

OHE MAST NO

26/1S 14 13 12 11 10 9 8 7 6 5 4 3 2 26/1 25 24 23 21 20 19 18 17 16 15 14 13 12 11 10 9 8L 7L 6L 5L 4L 3L 2L 25/1L

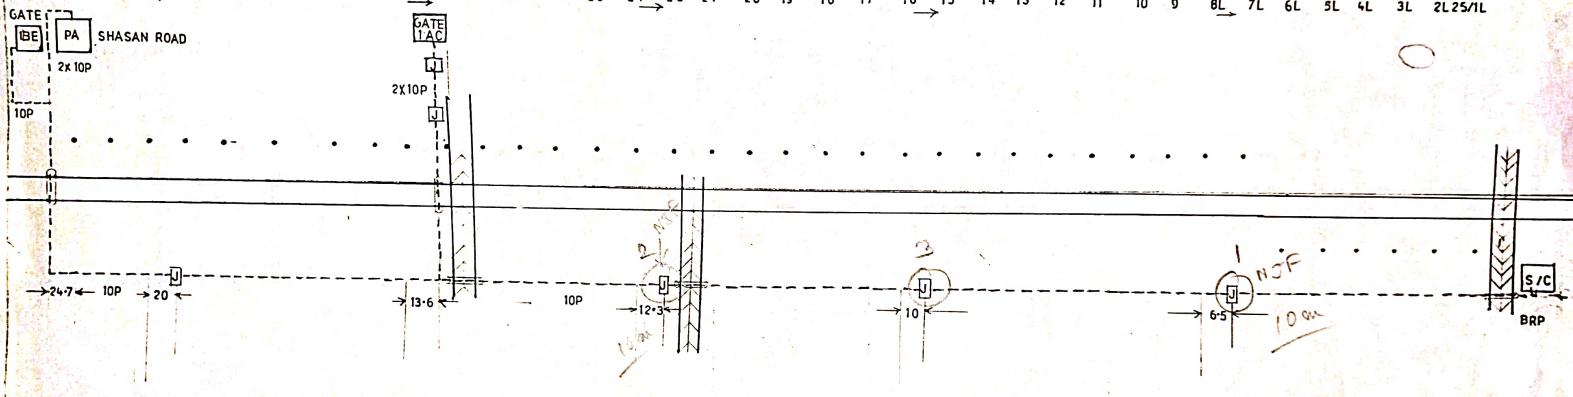

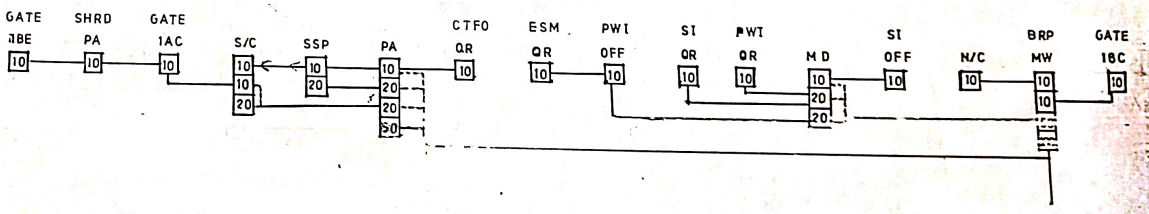

SHEET NO 3 OF 22

STATION	BARUIPUR
DRG. NO	PE/SS/CR/022
CHKD. BY	DATE 10.9.95


SDAH


DISTANCE BETWEEN OHE MAST & TRENCH

1.2 1.2 6 7.2 7 6 5.5 6 5.3 5.5 6.5 6.3 7.2 6.2 7 6.2 6 6.1 6 6.8 6.9 6.9 7.1 6.8 6.5 6.6 6.5 3.8 6.8 6.5 6.3 6.8 7.1 8.7 6.2 7 2.7 3.7

OHE MAST NO

15 14 13 12 11 10 9 8 7 6 5 4 3 2 20/1 18 17 16 15 14 13 12 11 10 9 8 7 6 5 4 3 22B/1 15 14 13 12 11 27/10

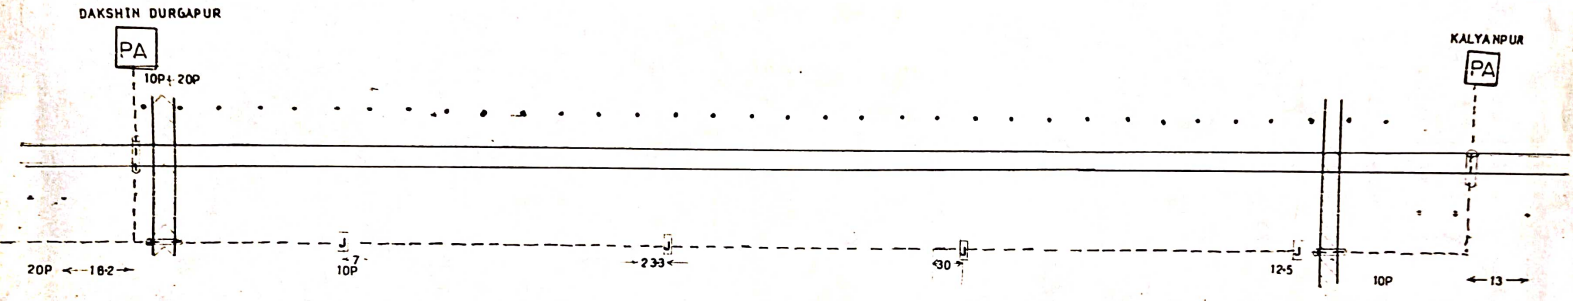

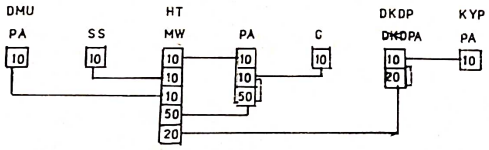

SHEET NO 1 OF 11

FIRM	PERFECTO ELECTRICALS
ADDRESS	18 M. B. ST. CAL 7
CLIENT	C. S. E. (CON) E. RLY. CAL
CONTRACT	18 GHZ CNL. COMMUN.
TITLE	CABLE ROUTE DRG.
STATION	HOTAR
DRG. NO	PE/SS/CR/011
CHKD. BY	DATE 10.8.95


SDAH

DISTANCE BETWEEN OHE MAST & TRENCH

1·4 2·9 1·2 2·2 1·3 4·2 1·7 2·6 1·2 1·3 1·1 1·2 1·1 1·2 1·8 1·4 1·3 1·3 1·3 1·3 6·5 8·6 8·5 6·5 6·5 6·1 6 6 5·4 5·2 6·1 7·6 6·4 6·5 5·5 6·3 6·2 1·5 1·2

OHE MAST NO

4 3 2 32/1 18 17 16 15 14 13 12 11 10 9 8 7 6 5 4 3 2 31/1 16 15 14 13 12 11 10 9 8 7 6 5 4 3 32/2 16 29/15

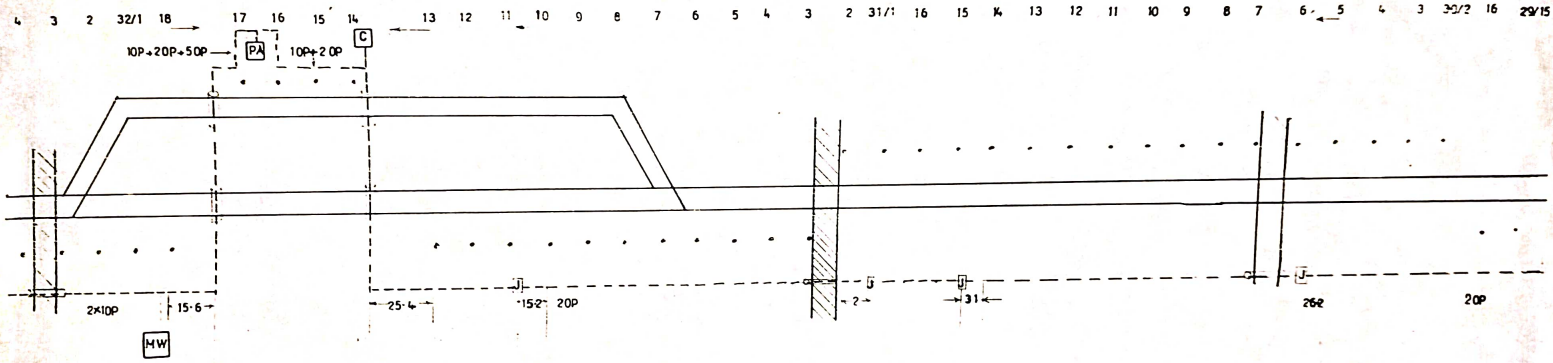

HOTOR


FIRM	PERFECTO ELECTRICALS
ADDRESS	18 M. B. ST. CAL 7
CLIENT	C. S. E. CON) E. RLY. CAL
CONTRACT	18 GHZ CNL. COMMUN.
TITLE	CABLE ROUTE DRG.
STATION	HOTAR
DRG. NO	PE/SS/CR/011
CHKD. BY	DATE 10.8.96

DISTANCE BETWEEN OHE MAST & TRENCH

1 15 16 67 66 7 72 75 64 63 69 61 7 86 63 83 63 67 72 71 69 66 58 6 62 65 X 7 61 12 15 12

OHE MAST NO

3 2 34/1 16 15 14 13 12 11 10 9 8 7 6 5 4 3 2 33/1 16 15 14 13 12 11 10 X 9 8 7 6 32/5

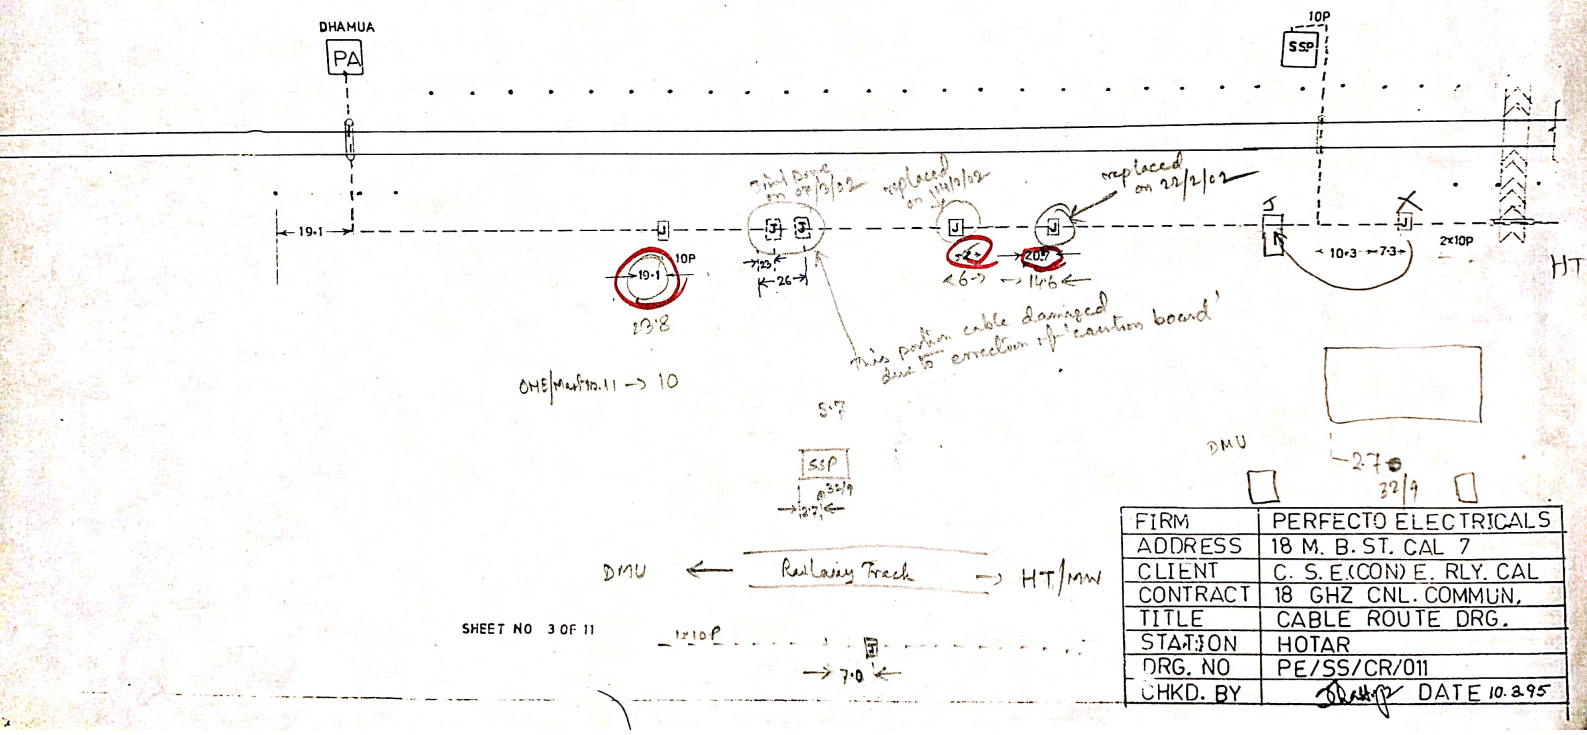

SHEET NO 3 OF 11


FIRM	PERFECTO ELECTRICALS
ADDRESS	18 M. B. ST. CAL 7
CLIENT	C. S. E.(CON) E. RLY. CAL
CONTRACT	18 GHZ CNL. COMMUN.
TITLE	CABLE ROUTE DRG.
STATION	HOTAR
DRG. NO	PE/SS/CR/011
CHKD. BY	DATE 10.2.95

DISTANCE BETWEEN OHE MAST & TRENCH

10·1 10·3 6·7 7 6·9 5·9 6·7 7 6·6 6·1 6·2 7 6·8 6·1 6·6 6·5 7 7·3 8 7·7 6·2 6·7 6·1 6·8 6·4 6·5 6·8 6·1 6·7 6·4 5·7 6·7 6·4 6·7 6·7 5·7 5·1 5·7 1·3 13

OHE MAST NO

16 15 14 13 12 11 10 9 8 7 6 5 4 3 2 38/1 16 15 14 13 12 11 10 9 8 7 6 5 4 3 2 37/1 16 15 14 13 12 11 36/10

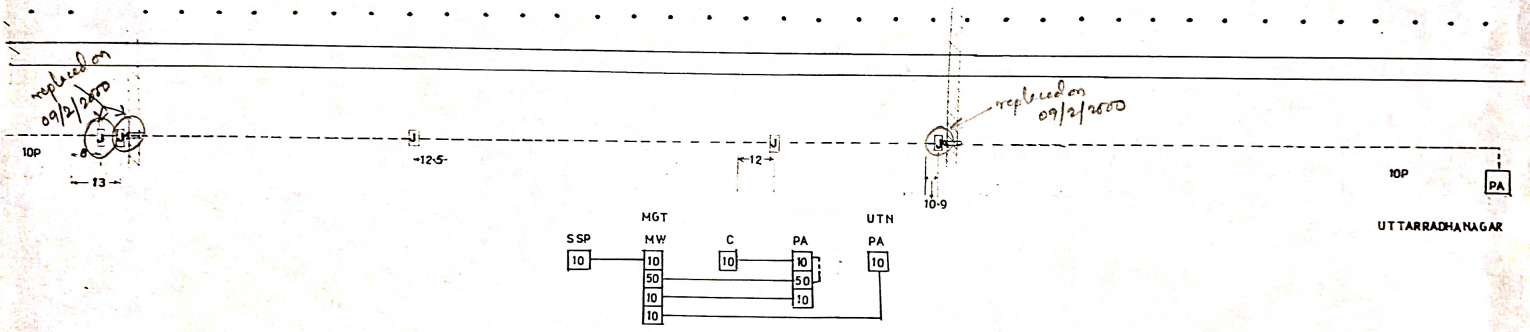

FIRM	PERFECTO ELECTRICALS
ADDRESS	18, M. B. ST. CAL 7
CLIENT	C. S. E.(CON) E. RLY. CAL
CONTRACT	18 GHZ CNL. COMMUN.
TITLE	CABLE ROUTE DRG
STATION	MAGRAHAT
DRG NO	PE/SS/CR/C12
CHKD. BY	DATE 10.3.95

SHEET NO 1 OF 12


SDAH

DISTANCE BETWEEN OHE MAST & TRENCH

3 7·3 7 1·5 1·2 2 5·9 14·0 15 11 10·9 9·7 1·5 3·8 2·1 1·5 1·5 2·9 3·1 3·7 10 10·2

OHE MAST NO

6 5 4 3 2 40/1 16 15A 14A 13 12 11 10 9 8 7 6 5 4 3 2 39/1

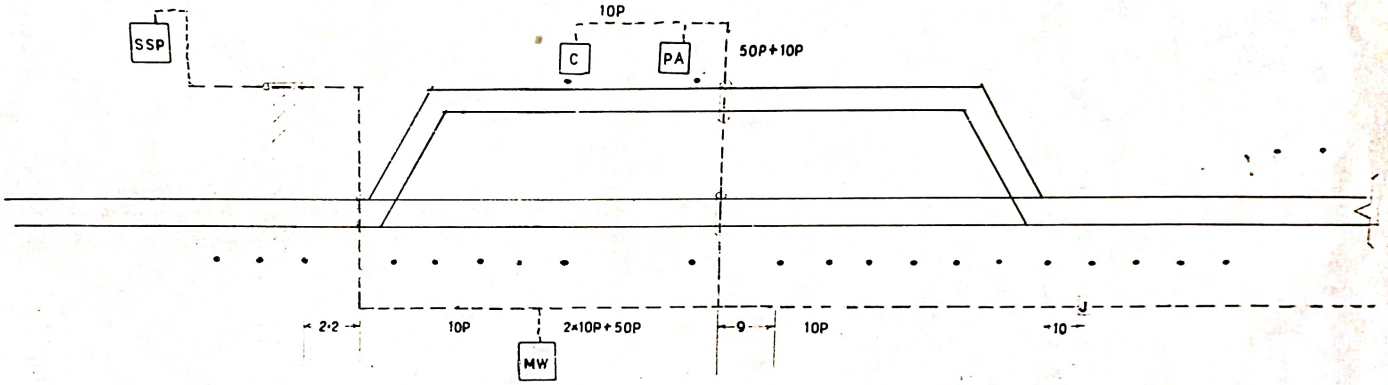

15 39/14

8·9 9·7

FIRM	PERFECTO ELECTRICALS
ADDRESS	18 M. B. ST. CAL 7
CLIENT	C. S. E.(CON)E. RLY. CAL
CONTRACT	18 GHZ CNL. COMMUN.
TITLE	CABLE ROUTE DRG.
STATION	MAGRAHAT
DRG NO	PE/SS/CR/012
CHKD BY	DATE 10.3.95


SHEET NO 2 OF 12


DISTANCE BETWEEN OHE MAST & TRENCH

0·9 4·8 2·1 5·6 6·9 7·6 7·4 7·2 9·1 7·7 7·7 7 7·1 8·2 7·8 6·9 5 9·5 9·8 10·1 9·3 9·7 9·3 7·9 7·4 6·2 6·2 6·5 7·8 7·4 8 5·6 7·6 7·4

O-E MAST NO

44/15 14 13 12 11 10 9 8 7 6 5 4 3 2 44/1 16 15 14 13 12 11 10 9 8 7 6 5 4 3 2 43/1 16 15 14 42/13

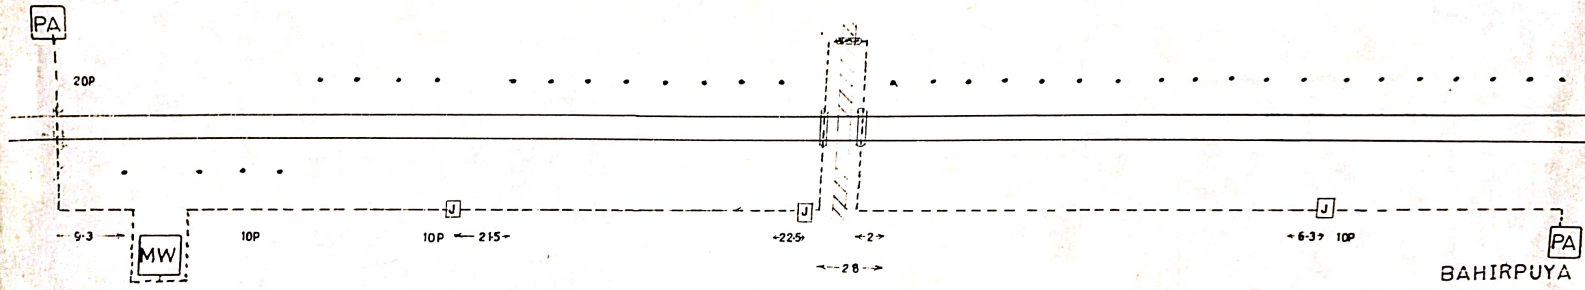




FIRM	PERFECTO ELECTRICALS
ADDRESS	18 M. B. ST. CAL 7
CLIENT	C. S. E.(CON) E. RLY. CAL
CONTRACT	18 GHZ CNL. COMMUN.
TITLE	CABLE ROUTE DRG.
STATION	SANGRAMPUR
DRG. NO	PE/SS/CR/013
CHKD. BY	DATE 10.3.95


SHEET NO 1 OF 13

2 2·7 2·8 1·2 7·6 1·2 5·4 5·2 6·8 9

OHE MAST NO


9 8 7 6 5A 4A 3A 2A 50/1A 49/17

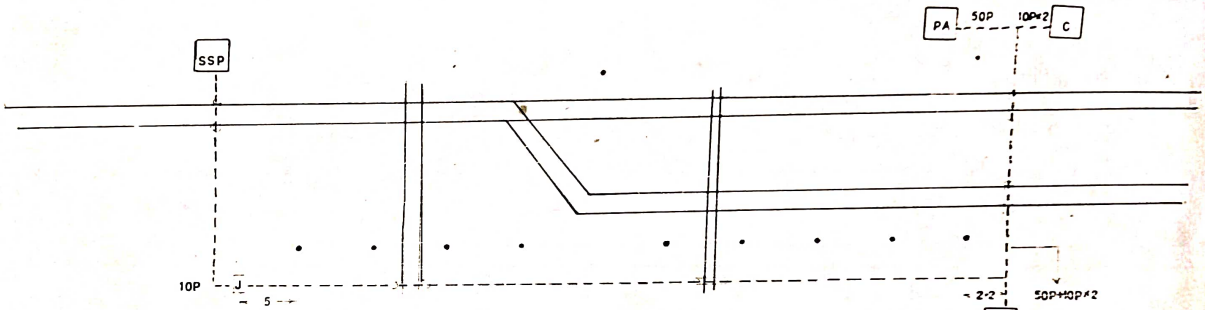




FIRM	PERFECTO ELECTRICALS
ADDRESS	18 M. B. ST. CAL 7
CLIENT	C. S. E.(CON) E. RLY. CAL
CONTRACT	18 GHZ CNL. COMMUN.
TITLE	CABLE ROUTE DRG.
STATION	DEULA
DRG. NO	PE/SS/CR/014
CHKD. BY	DATE 10.8.95

SHEET NO 1 OF 14

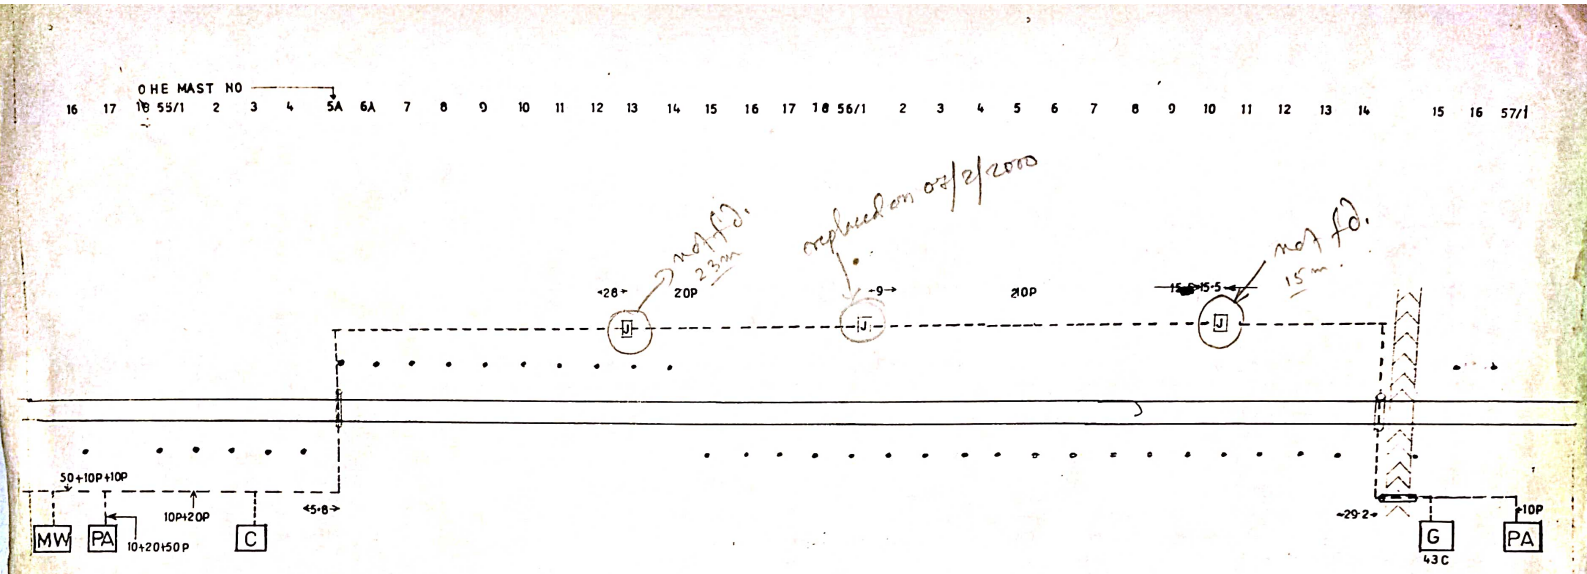

SHEET NO 1 OF 15

FIRM	PERFECTO ELECTRICALS
ADDRESS	18 M. B. ST. CAL 7
CLIENT	C. S. E.(CON)E, RLY. CAL
CONTRACT	18 GHZ CNL COMMUN.
TITLE	CABLE ROUTE DRG
STATION	BASULDANGA
DRG NO	PE/SS/CR/015
CHKD BY	

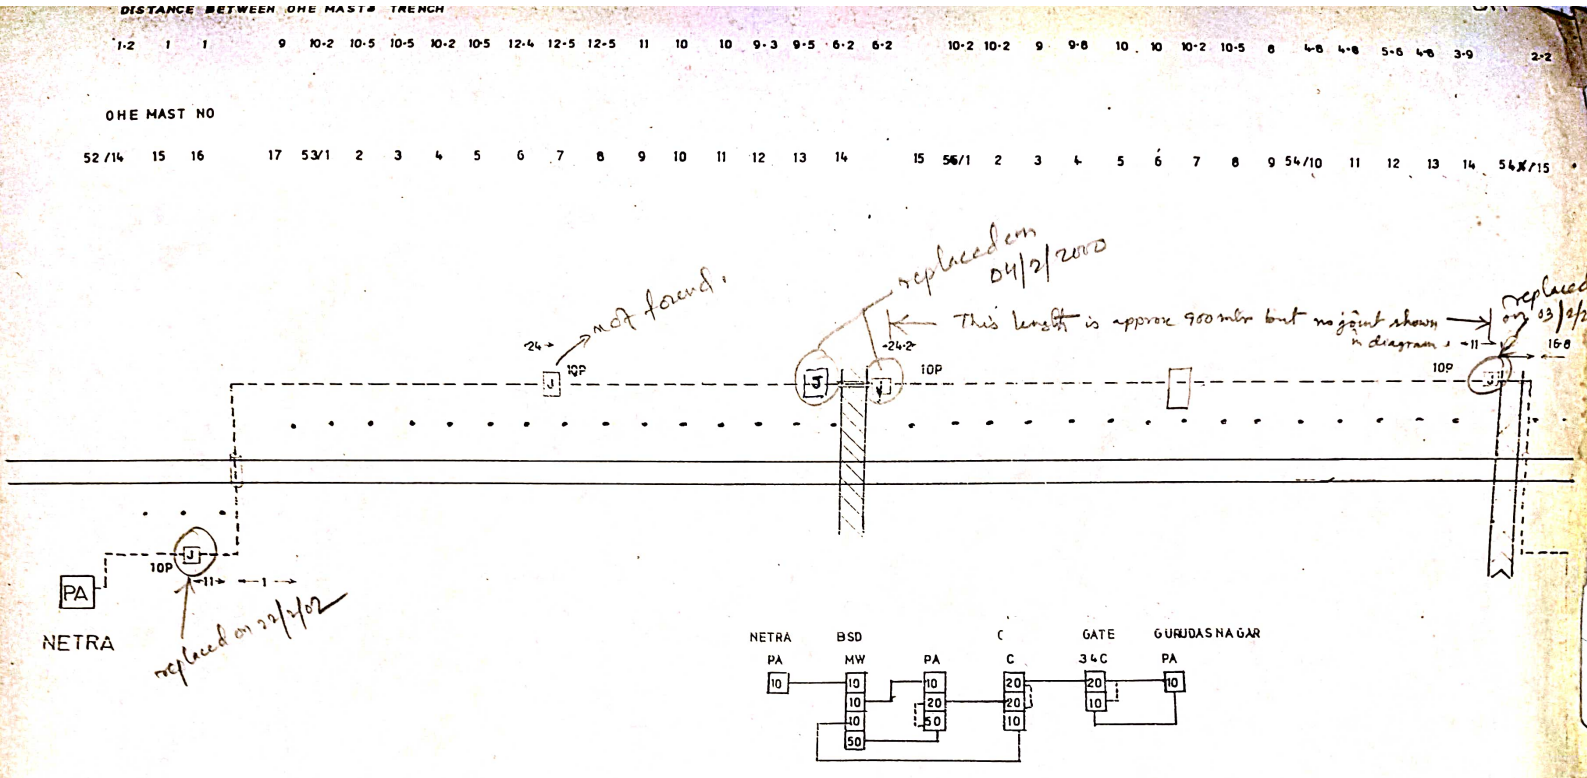


SHEET NO 2 OF 15

FIRM	PERFECTO ELECTRICALS
ADDRESS	18 M. B. ST. CAL 7
CLIENT	C. S. E.(CON) E. RLY. CAL
CONTRACT	18 GHZ CNL. COMMUN.
TITLE	CABLE ROUTE DRG.
STATION	BASULDANGA
DRG. NO	PE/SS/CR/015
CHKD. BY	DATE 10.3.


DISTANCE BETWEEN OHE MAST TRENCH

7	13·4	6·9	6·9	3	12	1	1	1	

OHE MAST NO 59/10B	11	12	12B	13	14	15B	16B	59/17B	17

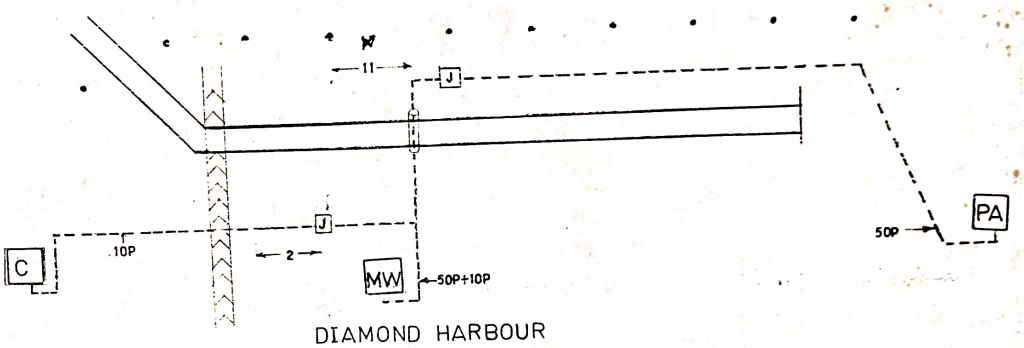

DIAMOND HARBOUR



FIRM	PERFECTO ELECTRCALS
ADDRESS	18 M B ST CAL 7
CLIENT	C.S.E CON E RLY CAL
CONTRACT	18 GHZ CNL COMMUN
TITLE	CABLE ROUTE DRG
STATION	DIAMOND HARBOU
DRG NO	PE/SS/CR/0
CHKD BY	

SHEET NO 1 OF 16